



LEXICOMM

IP66 TYPE A OUTSTATION



All Lexicomm Emergency Voice Communications Systems (EVCS) are designed to comply fully with the requirements of BS 5839-9:2021 for use as a fire telephone system (FT), disabled refuge system (DRS) or as a combined system when both fire telephones and disabled refuge call points are required.

- IP66 cased type A Handset
- Surface mount
- Fully Monitored to BS 5839-9:2021
- Red status LED
- Induction loop in Handset
- VAD Available for Steward Telephone systems.
- Twist lock or Key lock option

Overview

An EVCS is a fixed, secure, bi-directional, full duplex voice communication system to assist fire fighters during emergencies in high rise buildings or large sites where radio communication cannot be guaranteed to work due to interference from the fire plasma.

BS 5839-9:2021 covers the design, installation and operation of fire telephones and disabled refuge systems in buildings, and where both systems are fitted to a building, the standard specifies these should form a single system.

The ViLX-IPA2 is a type A EVCS outstation for use in outdoor or exposed areas and is compatible with the Lexicomm standalone and network EVCS systems.

The outstation is supplied within an compact IP66 enclosure which is externally signed as required by Building Regulations Approved Document B. The enclosure is opened by operation of a lever lock, exposing the handset, allowing a call to be made (a key lock option is available).

Suitability

The ViLX-IPA2 is a Type A outstation as defined in BS 5839-9:2021, and is designed to be used by the trained staff (such as fire marshals and stewards) in outdoor environments.

Type A outstations should be placed in fire telephone locations as described in Building Regulations Approved Document B and BS 9999:2017, or in stewards telephone locations as described in the FSADC design guide.

Mounting Instructions

The ViLX-IPA2 unit should be mounted at a height of 1300mm to 1400mm from the centre line to the finished floor level to comply with the requirements of BS 5839-9:2021


When drilling any holes for cable access ensure any bare metal is treated with an antioxidant primer, and all cable glands meet IP66 and are correctly tightened.

Ensure all mounting holes have the screw seals correctly fitted, failure to ensure this will compromise the IP rating of the enclosure.

Technical Specification

DETAILS	VILX-IPA2
PHYSICAL	
Height	300mm
Width	150mm
Depth	130mm to handle front
Weight	2800 g
Material	Texture painted Steel
Finish	Painted RAL 7035
OUTSTATION CABLES	
Type	Enhanced Fire Resistant
Cores	1 x 2 core radial 1mm or 1.5mm
Distance	500m from compatible panel
STANDARDS COMPLIANCE	
EMC	EN 55035:2017+A11:2020 EN 55032:2015+A1:2020
LVD	EN IEC62368-1:2020+A11:2020
Product Family	BS 5839-9:2021, BS 9999:2017 EN 60118-4:2015+A1:2018
PART NUMBERS	
Outstation	VILX-IPA2

Mounting

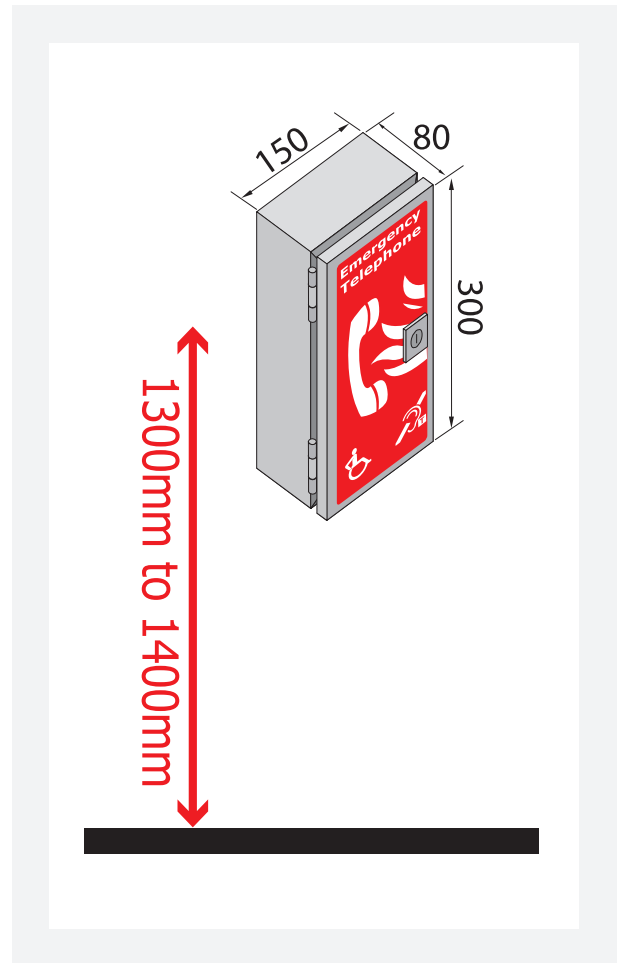

Connections

